


This Tank Meets or Exceeds The Requirements of N.J.A.C. 7:9A

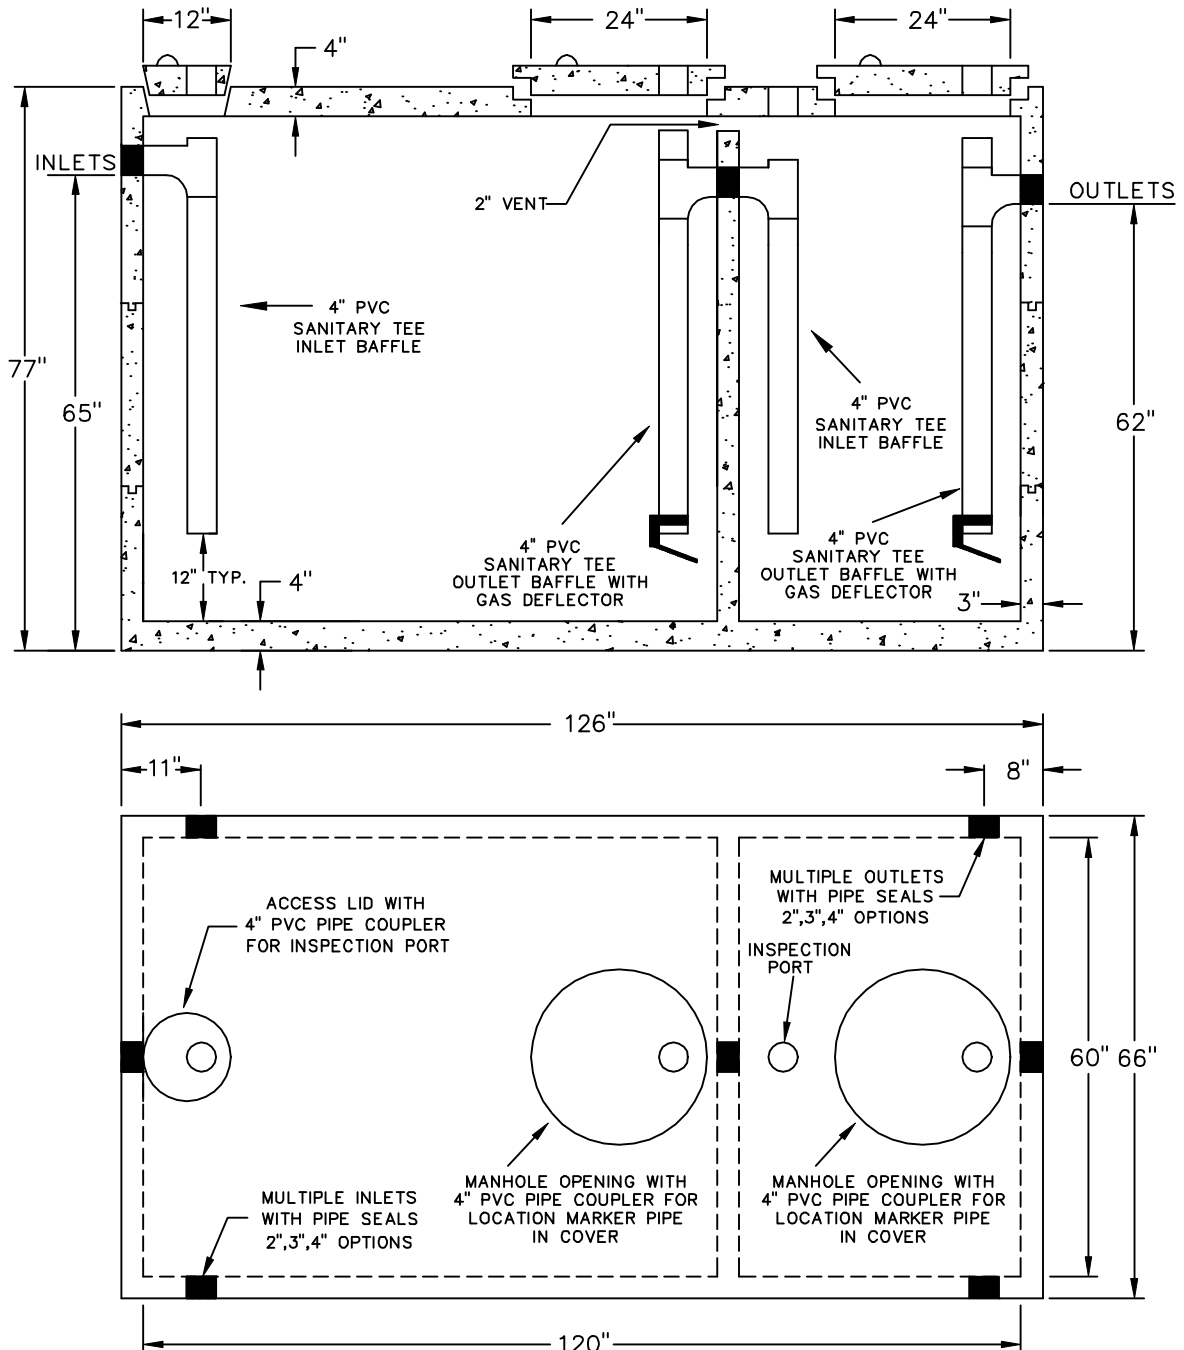

**SPECIFICATIONS** | **SEPTECH™ NJ 1750 GALLON 2-COMPARTMENT GREASE TRAP** | **NJ1750GT-2C**

Minimum Concrete Strength – 4000 P.S.I. @ 28 Days  
 Reinforcement – #3 & #4 Rebar in Top; 6"x6"x10 Ga. wire mesh in Sides & Bottom  
 Secondary Reinforcement Synthetic Fibers Throughout  
 Construction Joint – Sealed with Conseal CS-101 Butyl Resin Sealant  
 Design – Grease Trap to be As Manufactured By:  
**FLEMINGTON PRECAST & SUPPLY, L.L.C.**  
 18 Allen Street, Flemington, NJ 08822-1120  
 Ph. (908) 782-3246 Fax (908) 782-1981